

SIEMENS



TEC Controller

**Unit Conditioner - VAV Pressure
Dependent with Hot Water Heat,
Application 2041**


Application Note

Table of Contents


- Overview 4**
- Hardware Inputs 5
- Hardware Outputs..... 5
- Ordering Notes 5
- Sequence of Operation 6**
- Control Temperature Setpoints 6
- Room Temperature and CTL TEMP 7
- Day and Night Modes 8
- Night Mode Override Switch 8
- Heating/Cooling Switchover..... 8
- Control Loops 9
- Cooling Operation 9
- Heating Operation..... 9
- Hot Water Coil 9
- Sequencing Logic (Optional) 10
- Calibration..... 11
- Fail Mode Operation 12
- Application Notes 12
- Wiring Diagram 13
- Application 2041 Point Database 14**

Overview

In Application 2041, the controller modulates the supply air damper of the terminal box for cooling and modulates a reheat valve(s) for heating. When in heating, minimum airflow (limited by a mechanical stop on the terminal box) is provided to the room. In order for the terminal box to work properly, the central air-handling unit must provide cool supply air.

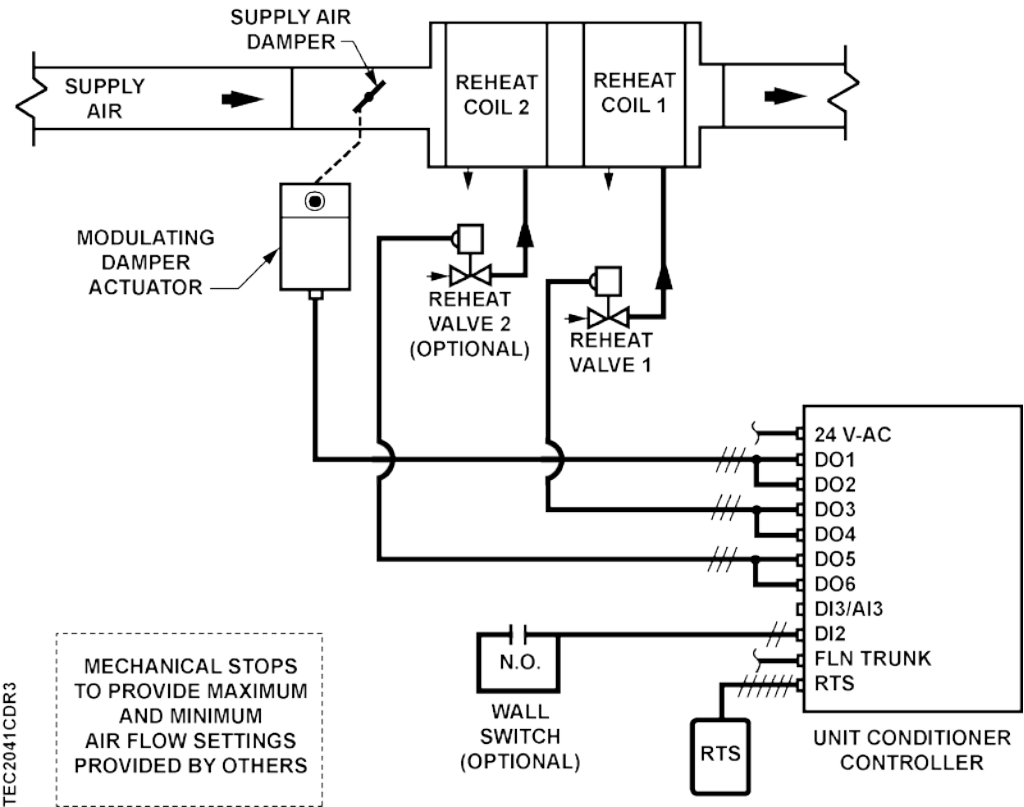

Application 2041 - VAV Pressure Dependent with Hot Water Reheat Control Diagram.

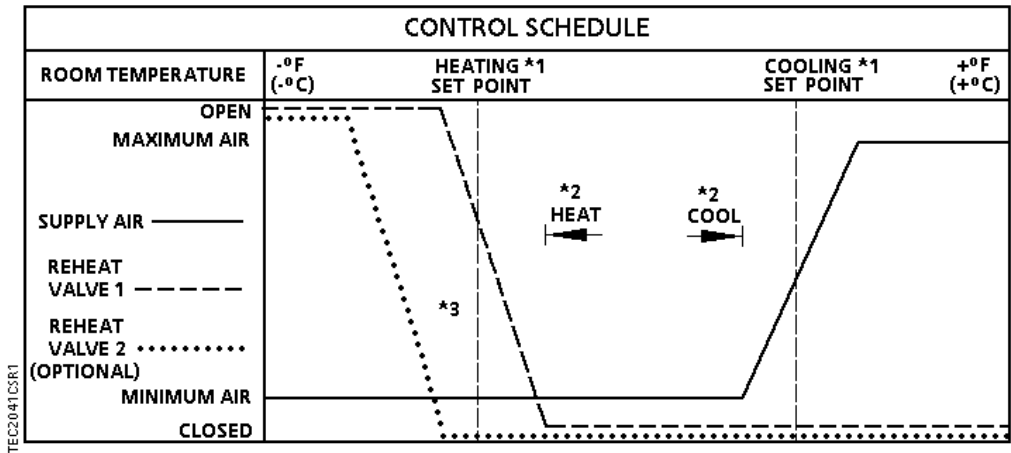

Application 2041 Control Schedule.



NOTES:

1. See *Control Temperature Setpoints*.
 2. See *Heating/Cooling Switchover*.
 3. The reheat valve is modulated.
 4. The airflow is shown at minimum in the entire heating mode.
-

Hardware Inputs

Analog

- Auxiliary temperature sensor (optional)
- Room temperature sensor
- Room temperature setpoint dial (optional)

Digital

- Night mode override (optional)
- Wall switch (optional)

Hardware Outputs

Analog

- None

Digital

- Damper actuator
- 1st valve actuator (required)
- 2nd valve actuator (optional)

Ordering Notes

540-110N

Siemens TEC Unit Conditioner Controller

Sequence of Operation

The following paragraphs present the sequence of operation for the Siemens TEC Unit Conditioner (Fan Coil) Controller.

Control Temperature Setpoints

This application has a number of different room temperature setpoints (DAY HTG STPT, NGT CLG STPT, RM STPT DIAL, etc.). The application actually controls using the CTL STPT. CTL STPT is set to different values depending on its override status, the time of day, whether or not a temperature deadband (zero energy band) has been configured, and the type of RTS used.

CTL STPT is Overridden:

If CTL STPT is overridden, that value is used regardless of any other settings. This disables the setpoint deadband feature.

CTL STPT in Night Mode:

The controller is in Night Mode if DAY.NGT = NGT and NGT OVRD = NGT.

When the controller is in night mode, CTL STPT holds the value of NGT CLG STPT or NGT HTG STPT depending on the value of HEAT.COOL. When the controller is in night mode the value of RM STPT DIAL is ignored.

CTL STPT in Day Mode:

The controller is in Day Mode if DAY.NGT = DAY or NGT OVRD = DAY.

Without setpoint dial:

When the controller is in day mode and STPT DIAL = NO, CTL STPT holds the value of DAY CLG STPT or DAY HTG STPT depending on the value of HEAT.COOL.

With setpoint dial:

When the controller is in day mode and STPT DIAL = YES, CTL STPT is set based on the value of the setpoint dial and the setpoint deadband.

The setpoint deadband exists to allow the controller to provide a separation of the heating and cooling temperature setpoints when a setpoint dial is enabled.

The setpoint deadband is the difference between the cooling and heating day setpoints (DAY CLG STPT - DAY HTG STPT). The setpoint deadband can be disabled by setting DAY HTG STPT equal to DAY CLG STPT. When DAY HTG STPT does not equal DAY CLG STPT, a setpoint deadband (or zero energy band) is used.

The following values are used in the calculation of CTL STPT:

- *Dial value* is the value of RM STPT DIAL limited between the value of RM STPT MIN and RM STPT MAX.
- *Deadband* is the value of the difference between DAY CLG STPT and DAY HTG STPT, half of which is applied to establish the current heating and cooling setpoints.
 - $Deadband = (DAY\ CLG\ STPT - DAY\ HTG\ STPT)$

CTL STPT is calculated as follows:

With Deadband Disabled:

CTL STPT = *Dial value*

With Deadband enabled in Heat Mode:

CTL STPT = *Dial value* – 0.5 * *Deadband* (limited between the value of RM STPT MIN and RM STPT MAX)


With Deadband enabled in Cool Mode:

CTL STPT = *Dial value* + 0.5 * *Deadband* (limited between the value of RM STPT MIN and RM STPT MAX).



NOTE:

If RM STPT DIAL is failed, it maintains the last known value.

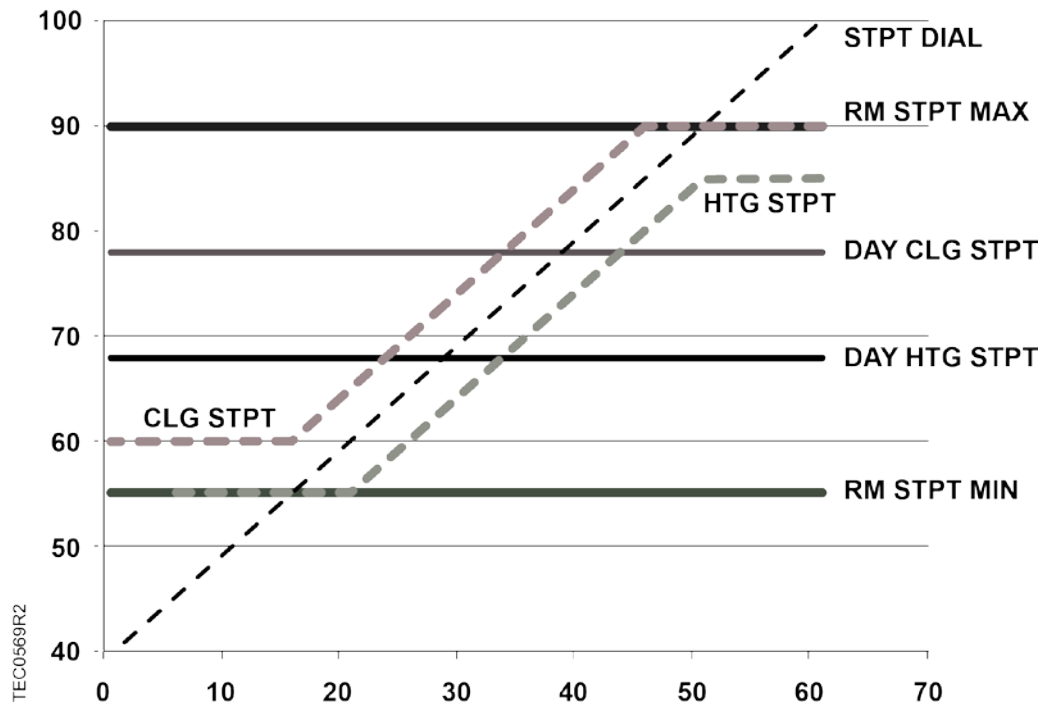

Room Temperature and CTL TEMP

ROOM TEMP is the temperature that is being sensed by the room temperature sensor (RTS).

CTL TEMP is the room temperature that is used for control purposes. In other words, what the application is trying to do is to maintain CTL TEMP at the control setpoint.

If CTL TEMP is overridden then:

- CTL TEMP equals its overridden value and ROOM TEMP has no effect on the value of CTL TEMP.

Day and Night Modes

The day/night status of the space is determined by the status of DAY.NGT. The control of this point differs depending on whether the controller is monitoring the status of a wall switch or if the controller is connected to a field panel.

When a wall switch is physically connected to the termination strip on the controller DI 2 (see the Control Diagram(s), and WALL SWITCH = YES, the controller monitors the status of DI 2.) When the status of DI 2 is ON (the switch is closed), then DAY.NGT will be set to DAY indicating that the controller is in day mode. When the status of DI 2 is OFF (the switch is open), then DAY.NGT will be set to NIGHT indicating that the controller is in night mode.

When WALL SWITCH = NO, the controller does not monitor the status of the wall switch, even if one is connected to it. In this case, if the controller is operating stand-alone, then the controller stays in day mode all the time. If the controller is operating with centralized control (that is, it is connected to a field panel), then the field panel can send an operator or PPCL command to override the status of DAY.NGT. See *Powers Process Control Language (PPCL) User's Manual* (125-1896) and *Field Panel User's Manual* (125-3019) or *BACnet Field Panel User's Manual* (125-3020) for more information.

Night Mode Override Switch

If an override switch is present on the room temperature sensor and a value (in hours) other than zero has been entered into OVRD TIME, pressing the override switch will reset the controller to DAY operational mode for the time period that is set in OVRD TIME. The status of NGT OVRD changes to DAY. After the override time elapses, the controller returns to night mode and the status of NGT OVRD changes back to NIGHT. The override switch on the room sensor will only affect the controller when it is in night mode.

Heating/Cooling Switchover

The heating/cooling switchover determines whether the controller is in heating or cooling mode by monitoring the room temperature and the demand for heating and cooling (as determined by the temperature control loops).

If the following conditions are met for the length of time set in SWITCH TIME, the controller switches from heating to cooling mode by setting HEAT.COOL to COOL:

- HTG LOOPOUT < SWITCH LIMIT.
- CTL TEMP > CTL STPT by at least the value set in SWITCH DBAND.
- CTL TEMP > the appropriate cooling setpoint minus SWITCH DBAND.

If the following conditions are met for the length of time set in SWITCH TIME, the controller switches from cooling to heating mode by setting HEAT.COOL to HEAT:

- CLG LOOPOUT < SWITCH LIMIT.
- CTL TEMP < CTL STPT by at least the value set SWITCH DBAND.
- CTL TEMP < the appropriate heating setpoint plus SWITCH DBAND.

Control Loops

The Siemens TEC Unit Conditioner (Fan Coil) Controller is controlled by two Proportional, Integral, and Derivative (PID) temperature loops.

The two temperature loops are a cooling loop and a heating loop. The active temperature loop maintains room temperature at the value in CTL STPT. See Control Temperature Setpoints [→ 6].

Cooling Operation

In cooling mode, the controller uses CTL STPT and CTL TEMP as inputs for the cooling loop.

The central air-handling unit must provide cool supply air. The output of the cooling loop is CLG LOOPOUT, which modulates the supply air damper; DMPR COMD. HTG LOOPOUT is set to 0%.

Heating Operation

In heating mode, the controller uses CTL STPT and CTL TEMP as inputs for the heating loop.

The output of the heating loop is HTG LOOPOUT, which modulates the hot water valve, VLV 1 COMD and VLV 2 COMD, in order to warm up the space. CLG LOOPOUT is set to 0%.

When in cooling mode, the heating valve is closed.

Hot Water Coil

The heating loop modulates the heating valve(s) in order to warm-up the space as follows:

- If there is only one heating valve, VALVE CNT = 1. The position of the heating valve, VLV 1 COMD, is calculated using the following formula:
$$(\text{HTG LOOPOUT} - \text{VLV 1 START}) / (\text{VLV 1 END} - \text{VLV 1 START}) \times 100\%$$
, limited between 0 and 100%.
As the demand for heating rises, the valve will begin opening when HTG LOOPOUT rises above VLV 1 START, and will be fully open when HTG LOOPOUT reaches VLV 1 END. VLV 2 COMD will not be used.
- If there are two heating valves, VALVE CNT = 2. The position of the first heating valve, VLV 1 COMD, is calculated as above. Similarly, the position of the second heating valve, VLV 2 COMD, is calculated using the following formula:
$$(\text{HTG LOOPOUT} - \text{VLV 2 START}) / (\text{VLV 2 END} - \text{VLV 2 START}) \times 100\%$$
, limited between 0 and 100%.
As the demand for heating rises, the second valve will begin opening when HTG LOOPOUT rises above VLV 2 START, and will be fully open when HTG LOOPOUT reaches VLV 2 END. See Sequencing Logic (optional) for information on how the two heating valves can be sequenced.




NOTE:

If a valve's start and end point values are set to the same value, the valve will not be used.

Sequencing Logic (Optional)

In heating mode, this application includes logic that allows two heating valves to operate in sequence, parallel, or overlapping. This algorithm is very similar to the spring range sequencing of valves and dampers. Portions of the output of the heating loop, HTG LOOPOUT, will drive the two heating valves from 0 to 100%. See the following three examples. The ladder diagrams below show sequenced, parallel, and overlapping valve operations. The vertical bars show the output of heating loopout from 0 to 100%. The horizontal bars (valve 1 start, valve 1 end, etc.) show the action that occurs when the loop output rises above the horizontal bar. The relative positions shown on the graphs are for illustration purposes only and may differ from the examples.

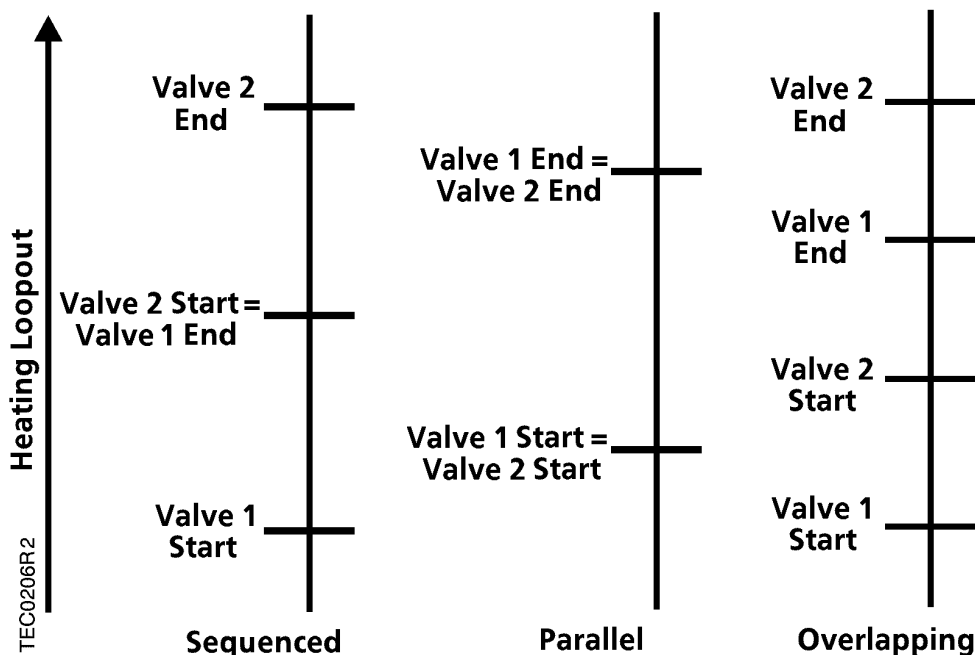

Example 1

Assume that your system has two hot water valves that are to operate in sequence. If:

- VLV 1 START=0%
- VLV 1 END = 50%
- VLV 2 START=50%
- VLV 2 END = 100%

then,

- When HTG LOOPOUT = 0%, VLV 1 COMD will equal 0% open and VLV 2 COMD will equal 0% open.

- When HTG LOOPOUT = 25%, VLV 1 COMD will equal 50% open and VLV 2 COMD will equal 0% open.
- When HTG LOOPOUT = 50%, VLV 1 COMD will equal 100% open and VLV 2 COMD will equal 0% open.
- When HTG LOOPOUT = 75%, VLV 1 COMD will equal 100% open and VLV 2 COMD will equal 50% open.
- When HTG LOOPOUT = 100%, VLV 1 COMD will equal 100% open and VLV 2 COMD will equal 100% open.

Example 2

Assume that your system has two hot water valves that are to operate in parallel. If:

- VLV 1 START=0%
- VLV 1 END = 100%
- VLV 2 START=0%
- VLV 2 END = 100%

then,

- When HTG LOOPOUT = 0%, VLV 1 COMD and VLV 2 COMD will equal 0% open.
- When HTG LOOPOUT = 50%, VLV 1 COMD and VLV 2 COMD will equal 50% open.
- When HTG LOOPOUT = 100%, VLV 1 COMD and VLV 2 COMD will equal 100% open.

Example 3

Assume that your system has two hot water valves that are to operate overlapping. If:

- VLV 1 START=0%
- VLV 1 END = 75%
- VLV 2 START=25%
- VLV 2 END = 100%

then,

- When HTG LOOPOUT = 0%, VLV 1 COMD and VLV 2 COMD will equal 0% open.
- When HTG LOOPOUT = 37.5%, VLV 1 COMD will equal 50% open and VLV 2 COMD will equal 15.5% open.
- When HTG LOOPOUT = 62.5%, VLV 1 COMD will equal 83% open and VLV 2 COMD will equal 50% open.
- When HTG LOOPOUT = 100%, VLV 1 COMD and VLV 2 COMD will equal 100% open.

Calibration

During normal operation: To ensure that the damper and valves open and close fully, the controller will provide additional opening and closing time when commanded DMPR COMD or VLV 1 COMD and VLV 2 COMD = 100% and 0%.

The controller regularly calibrates the valve(s) based on the value of CAL TIMER. A value of 12 indicates that the controller will calibrate the valve(s) once every 12 hours.

The calibration consists of driving the valve(s) closed, and then resetting the value of VLV 1 POS to 0. If a second valve is used, VLV 2 POS is also set to 0. The actuators are then released to normal control.

Floating Control Actuation Auto-correct

In addition to the existing options for floating control actuator full stroke actions; all floating control actuators are provided with additional logic to fully drive open or closed when commanded to 100% or 0%.

Fail Mode Operation


If the room temperature sensor fails, the controller operates using the last known temperature value.

Application Notes

- If temperature swings in the room are excessive or there is trouble maintaining the setpoint, the cooling loop, the heating loop, or both need to be tuned.
- The controller as shipped from the factory keeps all associated equipment OFF. See the *Start-up Procedures* document for how to release the controller and its equipment to application control.
- Spare DOs can be used as auxiliary points that are controlled by the field panel after being defined in the field panel's database. If a second heating valve is not being controlled by the application, DO 5 and DO 6 may be used as auxiliary motor points. If using the pair of spare DOs to control a motor, you must make sure that the motor setup, motor timing, and motor rotation angle are enabled correctly before you unbundle VLV 2 COMD. See *Start-up Procedures* document on Asset Portal or InfoLink for more information.

For more information, contact your nearest Siemens Industry, Inc. representative.

Wiring Diagram




⚠ CAUTION

The controller's DOs control 24 Vac loads only. The maximum rating is 12 VA for each DO. An external interposing relay is required for any of the following:

- VA requirements higher than the maximum
- 110 or 220 Vac requirements
- DC power requirements
- Separate transformers used to power the load

(for example part number 540-147, Terminal Equipment Controller Relay Module)

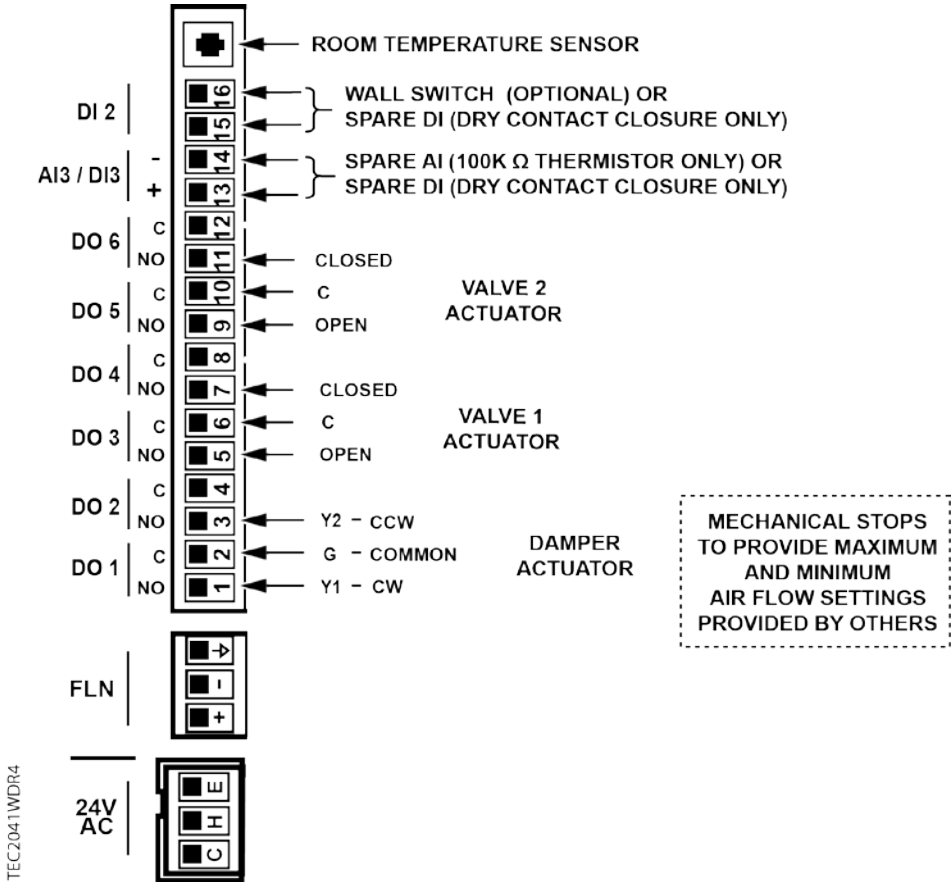

Application 2041 – Variable Air Volume Pressure Dependent with Hot Water Reheat.

Application 2041 Point Database

Point Number	Descriptor	Factory Default (SI Units) ²⁾	Eng Units (SI Units)	Slope (SI Units)	Intercept (SI Units)	On Text	Off Text
1	CTLR ADDRESS	99	--	1	0	--	--
2	APPLICATION	2090	--	1	0	--	--
{04}	ROOM TEMP	74.0 (23.44888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
{05}	HEAT.COOL	COOL	--	--	--	HEAT	COOL
6	DAY CLG STPT	74.0 (23.44888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
7	DAY HTG STPT	70.0 (21.20888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
8	NGT CLG STPT	82.0 (27.92888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
9	NGT HTG STPT	65.0 (18.40888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
11	RM STPT MIN	55.0 (12.80888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
12	RM STPT MAX	90.0 (32.40888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
{13}	RM STPT DIAL	74.0 (23.44888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
14	STPT DIAL	NO	--	--	--	YES	NO
{15}	AUX TEMP	74.0 (23.495556)	DEG F (DEG C)	0.5 (0.28)	37.5 (3.055556)	--	--
16	VLV 1 START	0	PCT	0.4	0	--	--
17	VLV 1 END	100	PCT	0.4	0	--	--
18	WALL SWITCH	NO	--	--	--	YES	NO
{19}	DI OVRD SW	OFF	--	--	--	ON	OFF
20	OVRD TIME	0	HRS	1	0	--	--
{21}	NGT OVRD	NIGHT	--	--	--	NIGHT	DAY
22	VLV 2 START	0	PCT	0.4	0	--	--
23	VLV 2 END	0	PCT	0.4	0	--	--
{24}	DI 2	OFF	--	--	--	ON	OFF
{25}	DI 3	OFF	--	--	--	ON	OFF
{29}	DAY.NGT	DAY	--	--	--	NIGHT	DAY
{37}	VLV 2 COMD	0	PCT	0.4	0	--	--
{38}	VLV 2 POS	0	PCT	0.4	0	--	--
39	MTR 3 TIMING	130	SEC	1	0	--	--
{41}	DO 1	OFF	--	--	--	ON	OFF

Point Number	Descriptor	Factory Default (SI Units) ²	Eng Units (SI Units)	Slope (SI Units)	Intercept (SI Units)	On Text	Off Text
{42}	DO 2	OFF	--	--	--	ON	OFF
{43}	DO 3	OFF	--	--	--	ON	OFF
{44}	DO 4	OFF	--	--	--	ON	OFF
{45}	DO 5	OFF	--	--	--	ON	OFF
{46}	DO 6	OFF	--	--	--	ON	OFF
{48}	DMPR COMD	0	PCT	0.4	0	--	--
{49}	DMPR POS	0	PCT	0.4	0	--	--
51	MTR 1 TIMING	130	SEC	1	0	--	--
{52}	VLV 1 COMD	0	PCT	0.4	0	--	--
{53}	VLV 1 POS	0	PCT	0.4	0	--	--
55	MTR 2 TIMING	130	SEC	1	0	--	--
56	MTR1 ROT ANG	90	--	1	0	--	--
57	MTR2 ROT ANG	90	--	1	0	--	--
58	MTR SETUP	0	--	1	0	--	--
59	DO DIR. REV	0	--	1	0	--	--
63	CLG P GAIN	20.0 (36.0)	--	0.25 (0.45)	0	--	--
64	CLG I GAIN	0.01 (0.018)	--	0.001 (0.0018)	0	--	--
65	CLG D GAIN	0 (0.0)	--	2 (3.6)	0	--	--
66	CLG BIAS	0	PCT	0.4	0	--	--
67	HTG P GAIN	10.0 (18.0)	--	0.25 (0.45)	0	--	--
68	HTG I GAIN	0.01 (0.018)	--	0.001 (0.0018)	0	--	--
69	HTG D GAIN	0 (0.0)	--	2 (3.6)	0	--	--
70	HTG BIAS	0	PCT	0.4	0	--	--
{78}	CTL TEMP	74.0 (23.44888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
{79}	CLG LOOPOUT	0	PCT	0.4	0	--	--
{80}	HTG LOOPOUT	0	PCT	0.4	0	--	--
85	SWITCH LIMIT	5.2	PCT	0.4	0	--	--
86	SWITCH TIME	10	MIN	1	0	--	--
88	VALVE CNT	1	--	1	0	--	--
90	SWITCH DBAND	1.0 (0.56)	DEG F (DEG C)	0.25 (0.14)	0	--	--
{92}	CTL STPT	74.0 (23.44888)	DEG F (DEG C)	0.25 (0.14)	48.0 (8.88888)	--	--
96	CAL TIMER	12	HRS	1	0	--	--
98	LOOP TIME	5	SEC	1	0	--	--

Point Number	Descriptor	Factory Default (SI Units) ²⁾	Eng Units (SI Units)	Slope (SI Units)	Intercept (SI Units)	On Text	Off Text
{99}	ERROR STATUS	0	--	1	0	--	--

- 1) Points not listed are not used in this application.
- 2) A single value in a column means that the value is the same in English units and in SI units.
- 3) Point numbers that appear in brackets { } may be unbundled at the field panel.

Issued by
Siemens Industry, Inc.
Building Technologies Division
1000 Deerfield Pkwy
Buffalo Grove IL 60089
Tel. +1 847-215-1000

© 2014 Copyright Siemens Industry, Inc.
Technical specifications and availability subject to change without notice.