



Fan Coil BACnet ASC Controller

Application Notes

Application 2546 — Cooling and Electric Heat

Table of Contents

Overview	3
BACnet	5
Hardware Inputs	6
Analog	6
Digital	6
Hardware Outputs	6
Analog	6
Digital	6
Ordering Notes.....	6
Point Database	6
Sequence of Operation	7
Control Temperature Setpoints.....	7
Room Temperature Offset	7
Day and Night Modes	7
Night Mode Override Switch.....	8
Heating/Cooling Switchover	8
Control Loops	8
Cooling Operation	9
Heating Operation	9
Electric Reheat.....	9
Fan Operation.....	10
Calibration.....	10
Fail-safe Operation	10
Application Notes	10

Wiring Diagram 11

Overview

In Application 2546, the controller energizes a valve or damper for cooling and controls a maximum of three stages of electric heat for heating in the fan coil unit. The fan coil unit also has a fan to circulate room air. This application can also be used to control a pressure-dependent terminal box with electric heat. If a damper is being controlled, the central plant must supply chilled air in the cooling mode in order for the terminal box to work properly (Figure 1 and Figure 3).

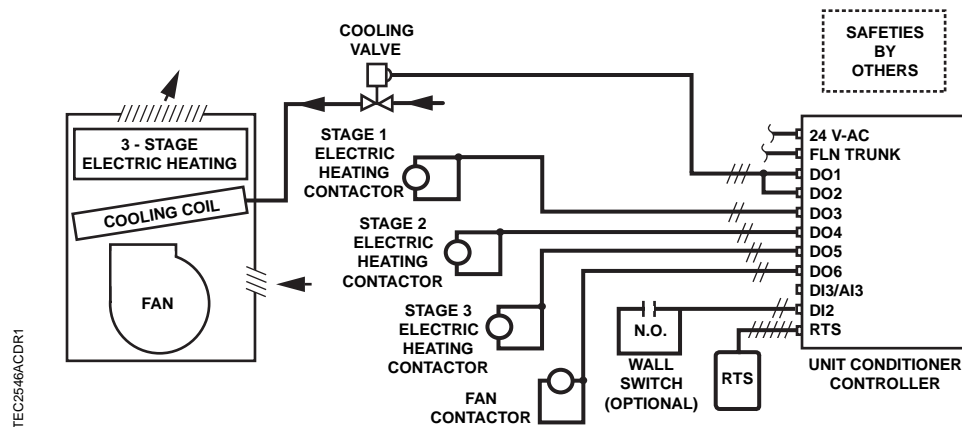


Figure 1. Application 2546 Staged Electric Heat with Cooling Valve Control Diagram.

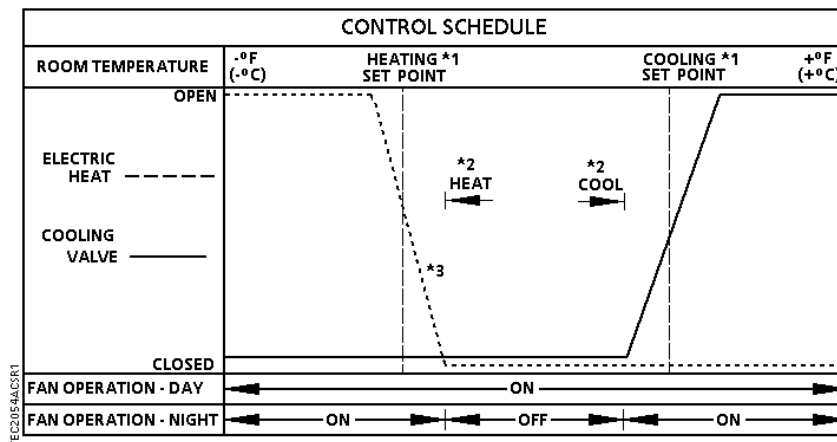


Figure 2. Application 2546 Control Schedule.

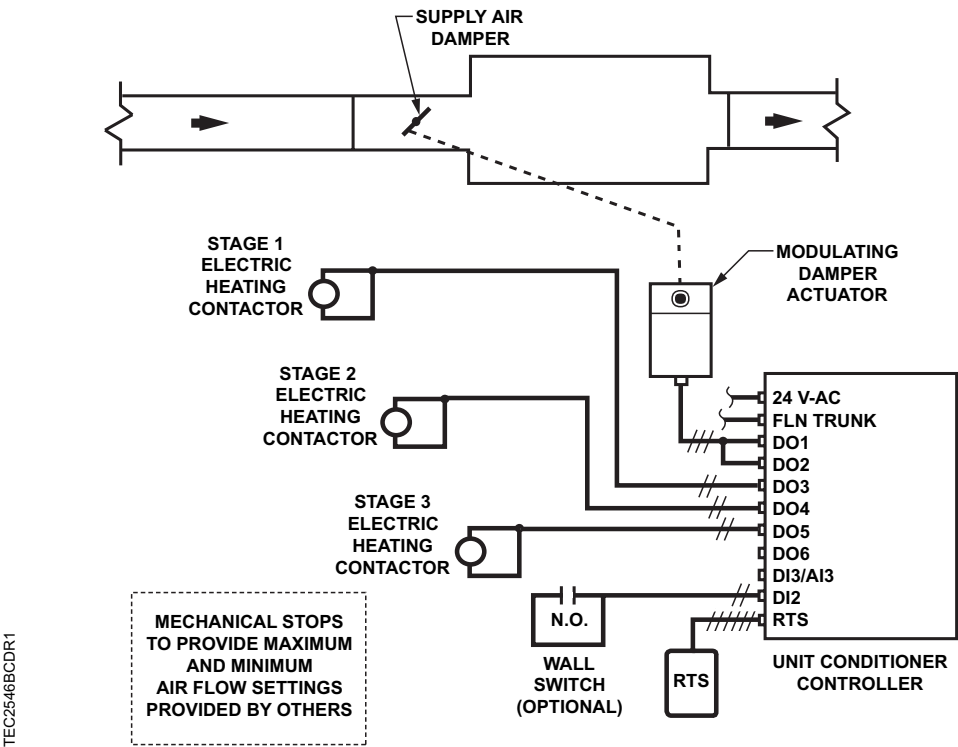


Figure 3. Application 2546 Staged Electric Heat Control Diagram.

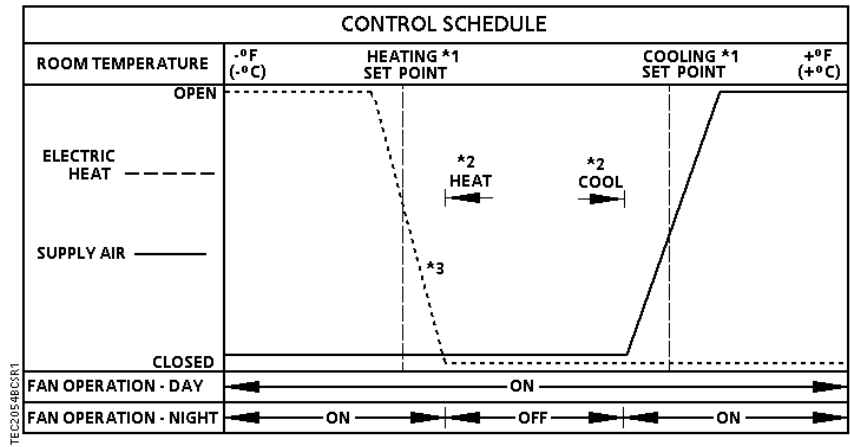


Figure 4. Application 2546 Staged Electric Heat Control Schedule.



See *Sequence of Operation, Control Temperature Setpoints*.

See *Sequence of Operation, Heating/Cooling Switchover*.

The electric heat is time-modulated. This allows it to be controlled proportionally rather than with deadbands.

BACnet

The Fan Coil BACnet ASC Controller communicates using BACnet MS/TP protocol for open communications on BACnet MS/TP networks.

Table 1. Supported BIBBS.

Product	Supported BIBBs	BIBB Name
BTEC	DS-RP-B	Data Sharing-Read Property-B
	DS-RPM-B	Data Sharing-Read Property Multiple-B
	DS-WP-B	Data Sharing-Write Property-B
	DM-DDB-B	Device Management-Dynamic Device Binding-B
	DM-DOB-B	Device Management-Dynamic Object Binding-B
	DM-DDC-B	Device Management-Device Communication Control-B

Hardware Inputs

Analog

- Room temperature sensor
- Room temperature setpoint dial (optional)

Digital

- Night mode override (optional)
- Wall switch (optional)

Hardware Outputs

Analog

- None

Digital

- Fan (switched 24 Vac, pilot duty)
- Stage 1 electric heat
- Stage 2 electric heat
- Stage 3 electric heat
- Valve actuator or damper actuator

Ordering Notes

Fan Coil BACnet ASC Controller

550-433

Related Equipment:

Terminal Equipment Controller Room Temperature Sensor

Point Database

Table 2 presents the point database information for Application 2546.

Sequence of Operation

The following paragraphs present the sequence of operation for Application 2546, "Fan Coil BACnet ASC Controller - Cooling and Electric Heat".

Control Temperature Setpoints

Depending on the controller's current operational mode (day or night), CTL STPT holds the value of one of the following setpoints:

Day Mode – CTL STPT holds the value of DAY CLG STPT or DAY HTG STPT. If the room temperature sensor has a setpoint dial and STPT DIAL = YES, CTL STPT holds the value of RM STPT DIAL.

If the setpoint dial is used and RM STPT DIAL < RM STPT MIN, CTL STPT holds the value of RM STPT MIN. If RM STPT DIAL > RM STPT MAX, CTL STPT holds the value of RM STPT MAX.

Night Mode – CTL STPT holds the value of NGT CLG STPT or NGT HTG STPT.

Room Temperature Offset



The Room Temperature Offset feature is optional.

RMTMP OFFSET is a user-adjustable offset that will compensate for deviations between the value of ROOM TEMP and the actual room temperature. This corrected value is displayed in CTL TEMP.

CTL TEMP = ROOM TEMP + RMTMP OFFSET

Example:

If the actual room temperature is 72.0°F, and the value of ROOM TEMP is 73.0°F, then the value entered into RMTMP OFFSET is -1.0. In this case, the value of ROOM TEMP would read 73.0°F, but the value of CTL TEMP would read 72.0°F.

Day and Night Modes

The day/night status of the space is determined by the status of DAY.NGT. The control of this point differs depending on whether the controller is monitoring the status of a wall switch or if the controller is connected to a field panel.

When a wall switch is physically connected to the termination strip on the controller at DI 2 (see Figure 1 and Figure 5), and WALL SWITCH = YES, the controller monitors the status of DI 2. When DI 2 is ON (the switch is closed), DAY.NGT will be set to DAY indicating that the controller is in day mode. When DI 2 is OFF (the switch is open), DAY.NGT will be set to NIGHT indicating that the controller is in night mode.

When WALL SWITCH = NO, the controller does not monitor the status of the wall switch, even if one is connected to it. In this case, the controller is operating stand-alone, it stays in day mode all the time. If the controller is operating with centralized control, connected to a field panel, the field panel can send an operator or PPCL command to override the status of DAY.NGT.

Night Mode Override Switch

If an override switch is present on the room temperature sensor and a value (in hours) other than zero has been entered into OVRD TIME, pressing the override switch will reset the controller to day mode for the amount of time set in OVRD TIME. The status of NGT OVRD changes to DAY. After the override time elapses, the controller returns to night mode and the status of NGT OVRD changes back to NIGHT.

The override switch on the room sensor will only affect the controller when in night mode.

Heating/Cooling Switchover

The heating/cooling switchover determines whether the controller is in heating or cooling mode by monitoring the room temperature and the demand for heating and cooling (as determined by the temperature control loops).

If the following conditions are met for the length of time set in SWITCH TIME, the controller switches from heating to cooling mode by setting HEAT.COOL to COOL:

- HTG LOOPOUT < SWITCH LIMIT.
- CTL TEMP > CTL STPT by at least the value set in SWITCH DBAND.
- CTL TEMP > the appropriate cooling setpoint minus SWITCH DBAND.

If the following conditions are met for the length of time set in SWITCH TIME, the controller switches from cooling to heating mode by setting HEAT.COOL to HEAT:

- CLG LOOPOUT < SWITCH LIMIT.
- CTL TEMP < CTL STPT by at least the value set in SWITCH DBAND.
- CTL TEMP < the appropriate heating setpoint plus SWITCH DBAND.

Control Loops

The Fan Coil BACnet ASC Controller is controlled by two Proportional, Integral, and Derivative (PID) temperature loops.

The two temperature loops are a cooling loop and a heating loop. The active temperature loop maintains room temperature at the value in CTL STPT. See *Sequence of Operation, Control Temperature Setpoints*.

Cooling Operation

In cooling mode, the controller uses CTL STPT and CTL TEMP as inputs for the cooling loop. If a valve is being controlled, the central plant must provide chilled water. If a damper is being controlled, the central plant must provide cool air. The output of the cooling loop is CLG LOOPOUT, which modulates either the cooling valve or the supply air damper; VLV CMD. HTG LOOPOUT is set to 0%.

Heating Operation

In heating mode, the controller uses CTL STPT and CTL TEMP as inputs for the heating loop. The output of the heating loop is HTG LOOPOUT, which modulates the electric reheat, in order to warm up the space. The valve is closed or the damper is resting on its mechanical stop. CLG LOOPOUT is set to 0%.

Electric Reheat



CAUTION:

Verify that the equipment is supplied with safeties by others to ensure that there is airflow across the heating coils when they are to be energized.

The heating loop controls up to three stages of electric reheat to warm up the room. The electric reheat is time modulated using a duty cycle as shown in the following example. When the controller is in cooling mode, the electric heat is OFF at all times.

Example

If the duty cycle is 10 minutes (HTG STG TIME = 10 minutes) and the heating loop is calling for 60% of heating (HTG LOOPOUT = 60%) for every 10-minute period, the stages of electric auxiliary heat cycle are as follows:

	Stage 1: minutes ON OFF	Stage 2: minutes ON OFF	Stage 3: minutes ON OFF
With 1 stage of electric heat:	6 4	--	--
With 2 stages of electric heat:	10 0	2 8	--
With 3 stages of electric heat:	10 0	8 2	0 10

Fan Operation



If this application is controlling a damper instead of a cooling valve, the fan operation is not applicable because there is no fan.

Day Mode – The fan may be set to stay ON at all times or to cycle to save energy. If CYCLE FAN = NO, the fan will be ON during the day. If CYCLE FAN = YES, the fan will cycle according to the following conditions:

1. If the first heating stage is ON or VLV COMD is open more than the value of STAGE FAN, the fan will turn ON.
2. If the first heating stage is OFF and has been OFF longer than the time set in HTG STG TIME , and the cooling valve is closed below the value of SWITCH LIMIT , the fan will turn OFF.
3. If neither of the above two conditions is met, the condition of the fan remains unchanged.

Night Mode – The fan cycles using the same three conditions described in the day mode section above, regardless of the setting of CYCLE FAN. If NGT OVRD = DAY (indicating that the night mode override button has been pressed), the fan is controlled as in day mode.

Calibration

The controller will regularly calibrate the cooling valve or damper, whichever is being used, based on the value of CAL TIMER. A value of 12 indicates that the controller will calibrate the actuator once every 12 hours.

The stages of electric heat are turned off during calibration. The calibration consists of driving the cooling valve or damper closed and resetting the value of VLV POS to 0. The actuator is then released to normal control.

Fail-safe Operation

If the room temperature sensor fails or the supply air temperature sensor fails, the controller operates using the last known temperature value.

Application Notes

1. Fan Coil BACnet ASC Controller , as shipped from the factory, keeps all associated equipment OFF. See the *BACnet Unit Conditioner/Fan Coil Start-up Procedures* for information on how to release the controller and its equipment to application control.
2. Spare DOs can be used as auxiliary points that are controlled by the field panel after being defined in the field panel's database. If a cooling valve is not being controlled by the application, DO 1 and DO 2 may be used as auxiliary motor points. If using a pair of spare DOs to control a motor, you must make sure that the motor setup, motor timing, and motor rotation angle are enabled correctly before you

unbundle VLV COMD. DO 3, DO 4, and DO 5 control the stages of electric heat. If less than three stages are being controlled by the application, the DOs that are not used will be spare. See *BACnet Unit Conditioner/Fan Coil Start-up Procedures* for more information.

Wiring Diagram

The point wiring for Application 2546 is shown in Figure 5.



CAUTION:

The controller's DOs control 24 Vac loads only. The maximum rating is 12 VA for each DO. Use an interposing 220V 4-relay module for any of the following:

- VA requirements higher than the maximum
- 110 or 220 Vac requirements
- DC power requirements
- Separate transformers used to power the load.

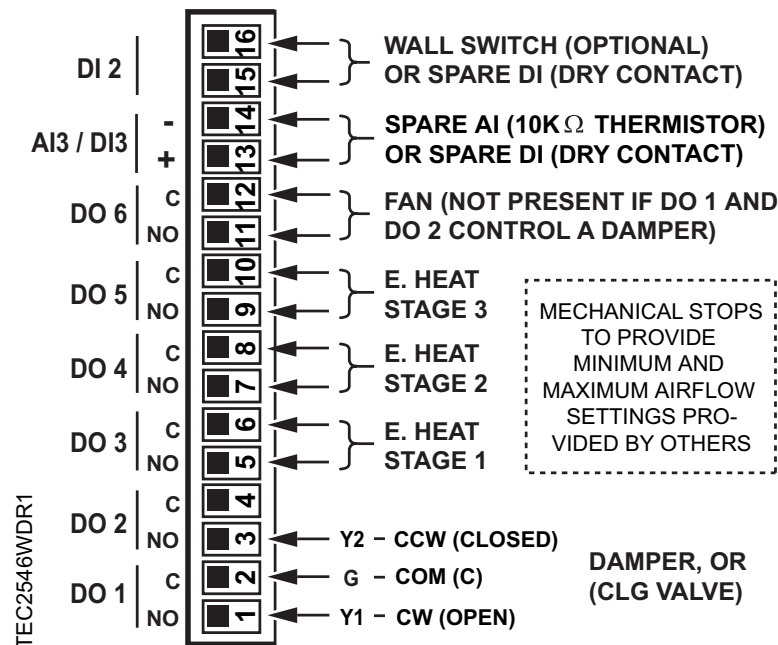


Figure 5. Application 2546 Wiring Diagram.

Table 2. Point Database for Application 2546.

Object Type ^a	Object Instance (Point Number) ^b	Object Name and Description	Factory Default (SI Units) ^c	Eng Units (SI Units) ^c	Range	Active Text	Inactive Text
AO	1	CTLR ADDRESS	99	–	0-255	–	–
AO	2	APPLICATION	2585	–	2528, 2529 and 2542 through 2546	–	–
AO	3	RMTMP OFFSET	0.0 (0.0)	DEG F (DEG C)	-31.75-32	–	–
AI	{04} ^d	ROOM TEMP	74.0 (23.44888)	DEG F (DEG C)	48-111.75	–	–
BO	{05}	HEAT.COOL	COOL	–	Binary	HEAT	COOL
AO	6	DAY CLG STPT	74.0 (23.44888)	DEG F (DEG C)	48-111.75	–	–
AO	7	DAY HTG STPT	70.0 (21.20888)	DEG F (DEG C)	48- 111.75	–	–
AO	8	NGT CLG STPT	82.0 (27.92888)	DEG F (DEG C)	48- 111.75	–	–
AO	9	NGT HTG STPT	65.0 (18.40888)	DEG F (DEG C)	48- 111.75	–	–
AO	11	RM STPT MIN	55.0 (12.80888)	DEG F (DEG C)	48- 111.75	–	–
AO	12	RM STPT MAX	90.0 (32.40888)	DEG F (DEG C)	48- 111.75	–	–
AI	{13}	RM STPT DIAL	74.0 (23.44888)	DEG F (DEG C)	48- 111.75	–	–
BO	14	STPT DIAL	NO	–	Binary	YES	NO
AI	{15}	AUX TEMP AI3	74.0 (23.495556)	DEG F (DEG C)	37.5- 165	–	–
BO	18	WALL SWITCH	NO	–	Binary	YES	NO
BI	{19}	DI OVRD SW	OFF	–	Binary	ON	OFF
AO	20	OVRD TIME	0	HRS	0- 255	–	–
BO	{21}	NGT OVRD	NIGHT	–	Binary	NIGHT	DAY
BI	{24}	DI 2	OFF	–	Binary	ON	OFF
BI	{25}	DI 3	OFF	–	Binary	ON	OFF
BO	{29}	DAY.NGT	DAY	–	Binary	NIGHT	DAY

continued on next page...

Table 2. Point Database for Application 2546. (continued)

Object Type ^a	Object Instance (Point Number) ^b	Object Name and Description	Factory Default (SI Units) ^c	Eng Units (SI Units) ^c	Range	Active Text	Inactive Text
BO	{41}	DO 1	OFF	–	Binary	ON	OFF
BO	{42}	DO 2	OFF	–	Binary	ON	OFF
BO	{43}	HTG STG 1	OFF	–	Binary	ON	OFF
BO	{44}	HTG STG 2	OFF	–	Binary	ON	OFF
BO	{45}	HTG STG 3	OFF	–	Binary	ON	OFF
BO	{46}	FAN	OFF	–	Binary	ON	OFF
AO	{48}	VLV COMD	0	PCT	0- 102	–	–
AO	{49}	VLV POS	0	PCT	0- 102	–	–
AO	51	MTR 1 TIMING	130	SEC	0- 511	–	–
AO	56	MTR1 ROT ANG	90	–	0- 255	–	–
AO	58	MTR SETUP	0	–	0- 255	–	–
AO	59	DO DIR. REV	0	–	0- 255	–	–
BO	60	CYCLE FAN	NO	–	Binary	YES	NO
AO	63	CLG P GAIN	20.0 (36.0)	–	0- 63.75	–	–
AO	64	CLG I GAIN	0.01 (0.018)	–	0- 1.023	–	–
AO	65	CLG D GAIN	0 (0.0)	–	0- 510	–	–
AO	66	CLG BIAS	0	PCT	0- 102	–	–
AO	67	HTG P GAIN	10.0 (18.0)	–	0- 63.75	–	–
AO	68	HTG I GAIN	0.01 (0.018)	–	0- 1.023	–	–
AO	69	HTG D GAIN	0 (0.0)	–	0- 510	–	–
AO	70	HTG BIAS	0	PCT	0- 102	–	–
AO	{78}	CTL TEMP	74.0 (23.44888)	DEG F (DEG C)	48- 111.75	–	–
AO	{79}	CLG LOOPOUT	0	PCT	0- 102	–	–
AO	{80}	HTG LOOPOUT	0	PCT	0- 102	–	–
AO	{81}	AVG HEAT OUT	0	PCT	0- 409.2	–	–
AO	82	HTG STG MAX	90	PCT	0- 102	–	–
AO	83	HTG STG MIN	10	PCT	0- 102	–	–

continued on next page...

Table 2. Point Database for Application 2546. (continued)

Object Type ^a	Object Instance (Point Number) ^b	Object Name and Description	Factory Default (SI Units) ^c	Eng Units (SI Units) ^c	Range	Active Text	Inactive Text
AO	84	STAGE FAN	10	PCT	0- 102	–	–
AO	85	SWITCH LIMIT	5.2	PCT	0- 102	–	–
AO	86	SWITCH TIME	10	MIN	0- 255	–	–
AO	88	HTG STG CNT	1	–	0- 255	–	–
AO	89	HTG STG TIME	10	MIN	0- 255	–	–
AO	90	SWITCH DBAND	1.0 (0.56)	DEG F (DEG C)	0- 63.75	–	–
AO	{92}	CTL STPT	74.0 (23.44888)	DEG F (DEG C)	48- 111.75	–	–
AO	96	CAL TIMER	12	HRS	0- 255	–	–
AO	98	LOOP TIME	5	SEC	0- 255	–	–
AO	{99}	ERROR STATUS	0	–	0- 255	–	–
^a Object Types are; Analog Input (AI), Analog Output (AO), Binary Input (BI) and Binary Output (BO). ^b Points not listed are not used in this application. ^c A single value in a column means that the value is the same in English units and in SI units. ^d Point numbers that appear in brackets {} may be unbundled at the field panel.							